

Model 600

Water Pressure Reducing Valve with Integral By-pass Check Valve and Strainer

SPECIFICATION S R۱



FEATURES
Sizes: 🛛 ½" 🔾 ¾" 🖓 1" 🖓 1¼" 🖓 1½" 🖓 2"
Maximum working water pressure 300 psi
Maximum working water temperature 140°F
Reduced pressure range (standard) 25 psi to 75 psi
Factory preset 50 psi
Hydrostatic test pressure 300 psi
CPVC tailpiece: Max. hot water temp. 140°F @ 100 psi
Cold water rated temp. 73.4°F @ 400 psi
OPTIONS (Suffixes can be combined)
 standard with 20 mesh strainer screen
C - copper sweat connection (3/4" thru 2")
\square DM - double male meter tailpiece connection (3/4);
1" National Hose Thread fits 5/8" x 3/4" and
3/4" water meters (no union included)
HR - 75 psi to 125 psi spring range, factory set at 85 psi
□ HLR - 10 psi to 125 psi spring range, factory set at 50 psi
□HTSTSC- 180°F maximum temp, stainless steel trim,
spring, sealed cage
L - less integral by-pass check valve
LU - less union assembly, female x female (3/4" & 1" only)
LPV - 180°F maximum temp with 10 psi to 35 psi
spring range, factory set at 20 psi
□ LPC - 140°F maximum temp with 10 psi to 35 psi
spring range, factory set at 20 psi (2" field
set only)
SC - sealed cage bell housing and stainless steel
adjustment screw
610 - 400 psi inlet rating and 75 psi to 125 psi
spring range, factory set at 85 psi
P - tapped and plugged for gauge
CPVC - CPVC tailpiece connection (1/2"-1")
G - Tapped with gauge

- CH Chrome stem & plunger
- SS - Stainless Steel stem

DIMENSIONS & WEIGHTS (do not include pkg.)

APPLICATION


Designed for installation on potable water lines to reduce high inlet pressure to a lower outlet pressure. The integral strainer makes this device most suitable for residential and commercial water systems requiring frequent cleaning because of sediment and debris. The direct acting integral by-pass design prevents buildup of excessive system pressure caused by thermal expansion. The balanced piston design enables the regulator to react in a smooth and responsive manner to changes in system flow demand, while at the same time, providing protection from inlet pressure changes.

STANDARDS COMPLIANCE

- ASSE® Listed 1003
- IAPMO® Listed
- CSA® Certified
- City of Los Angeles Approved

MATERIALS


Main valve body	Cast Bronze ASTM B 584
Access covers	Cast Bronze ASTM B 584
	Brass ASTM B 16
Fasteners	Stainless Steel, 300 Series
Stem & plunger	Cast Bronze ASTM B 584
	Brass ASTM B 16
Elastomers	Buna Nitrile, (FDA Approved)
	EPDM, (FDA Approved)
Cap gaskets	Natural Vulcanized Fibre
	Acetal (Delrin™), NSF Listed
Strainer screen	Stainless Steel, 300 Series
	⊧ — D — →



DIMENSIONS & WEIGHTS (do not include pkg.)						► A►							
617	7		DIMENSIONS (approximate)							WEIGHT			
SIZE		CONNECTIONS	A		В		С	С		D			
in.	mm		in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg.	
1/2	15	SINGLE UNION	5 1/2	133	6 1/4	159	1 1/4	32	2 3/4	70	3	1.5	
1/2	15	LESS UNION	4 1/2	114	6 1/4	159	1 1/4	32	2 3/4	70	3	1.5	
3/4	20	SINGLE UNION	5 5/16	135	5 1/2	140	1 1/4	32	2 3/4	70	3	1.5	
3/4	20	LESS UNION	4 7/8	121	5 1/2	140	1 1/4	32	2 3/4	70	3	1.5	
1	25	SINGLE UNION	6 1/8	156	7 1/4	184	2	51	3 3/8	86	5	2.5	
1	25	LESS UNION	5 3/4	146	7 1/4	184	2	51	3 3/8	86	5	2.5	
1 1/4	32	SINGLE UNION	7 1/8	181	8	203	2	51	3 7/8	100	7	3.0	
1 1/2	40	SINGLE UNION	9 1/8	232	10	254	2 1/2	64	5	127	13	6.0	
2	50	SINGLE UNION	10 1/4	260	12	305	3	76	6 1/2	165	21	9.5	


REVISION: DOCUMENT #: 6/11 **REG-600**

WILKINS a Zurn Company, 1747 Commerce Way, Paso Robles, CA 93446 Phone: 805/238-7100 Fax: 805/238-5766 In Canada: ZURN INDUSTRIES LIMITED, 3544 Nashua Dr., Mississauga, Ontario L4V 1L2 Phone: 905/405-8272 Fax: 905/405-1292 Product Support Help Line: 1-877-BACKFLOW (1-877-222-5356) • Website: http://www.zurn.com

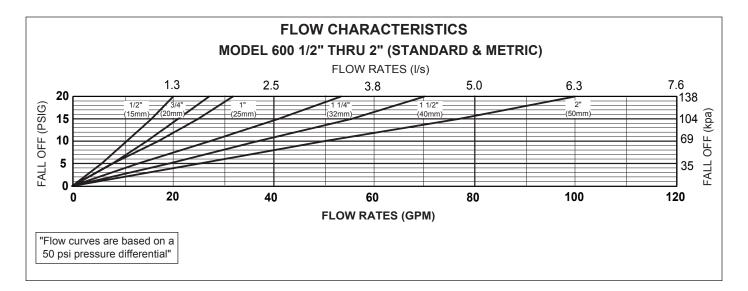

TYPICAL INSTALLATION

Local codes shall govern installation requirements. Unless otherwise specified, the assembly shall be mounted in accordance with the latest edition of the Uniform Plumbing Code. The Model 600 may be installed in any position. If installed in a pit, vault or inside application, specify the "SC" sealed cage option. Multiple installations are recommend for wide demand variations or where the desired pressure reduction is more than 4 to 1 (i.e.: 200 psi inlet reduced to 50 psi outlet). <u>CAUTION:</u> Anytime a reducing valve is adjusted, a pressure gauge must be used downstream to verify correct pressure setting. Do not bottom adjustment bolt on bell housing.

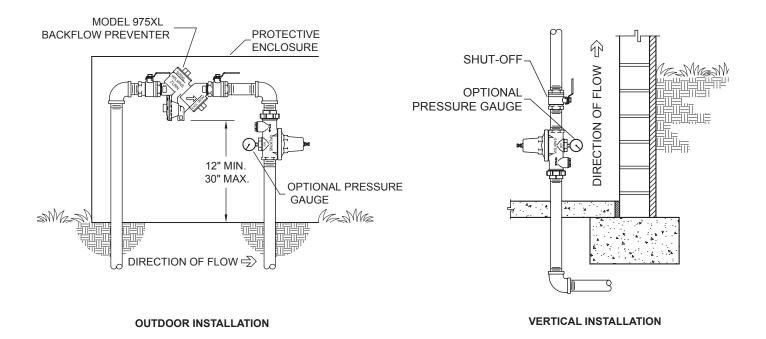

SPECIFICATIONS

The Pressure Reducing Valve shall consist of a bronze body and bell housing, shall have separate access covers for the plunger and strainer screen and shall have a bolt to adjust the downstream pressure. The Pressure Reducing Valve shall be of the balanced piston design and shall reduce pressure in both flow and no-flow conditions. The bronze bell housing and access caps shall be threaded to the body and shall not require the use of ferrous screws. The Pressure Reducing Valve shall be a WILKINS Model 600.

WILKINS a Zurn Company, 1747 Commerce Way, Paso Robles, CA 93446 Phone:805/238-7100 Fax:805/238-5766 In Canada: ZURN INDUSTRIES LIMITED, 3544 Nashua Dr., Mississauga, Ontario L4V 1L2 Phone:905/405-8272 Fax:905/405-1292 Product Support Help Line: 1-877-BACKFLOW (1-877-222-5356) • Website: http://www.zurn.com